

**II. Suggested Format for the HYDRO General Permit Notice of Intent (NOI):**

**Request for General Permit Authorization to Discharge Wastewater Notice of Intent (NOI) to be covered by Hydroelectric Generating Facilities General Permit (HYDROGP) No. MAG360000 or NHG360000**

Indicate Applicable General Permit for Discharge(s):       MAG360000                       NHG360000

**A. Facility Information**

1. Facility Location	Name: SMITH HYDROELECTRIC STATION	
	Street: 99 GLEN AVENUE	
	City: BERLIN	State: NEW HAMPSHIRE
	Zip: 03570	SIC Code: 4911
	Latitude: N44° 27' 54.8"	Longitude: W71° 11' 03.5"
	Type of Business: ELECTRIC POWER GENERATION	
2. Facility Mailing Address (if different from Location)	Street: 670 N. COMMERCIAL ST SUITE 204	
	City: MANCHESTER	State: NEW HAMPSHIRE
	Zip: 03101	
3. Facility Owner	Name: PATRIOT HYDRO, LLC	Email: SILLER@PATRIOTHYDRO.COM
	Street: 670 N. COMMERCIAL ST SUITE 204	Telephone: (603) 540 - 8238

	City: MANCHESTER	State: NEW HAMPSHIRE
	Contact Person: SEAN ILLER	Zip: 03101
4. Facility Operator (if different from above)	Name:	Email:
	Street:	Telephone:
	City:	State:
	Zip:	
5. Current Permit Status	Has prior HYDROGP coverage been granted for the discharge(s) listed in the NOI?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No
	Permit number (if yes): NH0001481	
	Is the facility covered under an Individual Permit?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No
	Is there a pending NPDES application of file with EPA for the discharge(s)?	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
	Date of Submittal (if yes): Click or tap to enter a date.	Permit Number (if known):
	Attach a topographic map indicating the locations. of the facility and outfall(s) to the receiving water	<input checked="" type="checkbox"/> Map Attached
	Number of turbines: 1	
	Combined turbine discharge (installed capacity) at:	Maximum capacity? 3000 cfs Minimum capacity? 0 cfs
	Is this facility operated as a pump storage project?	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No

Appendix 4 – NPDES Hydroelectric Facilities General Permit

**B. Discharge Information**

1. Name of Receiving Water(s): ANDROSCOGGIN RIVER		<input checked="" type="checkbox"/> Freshwater <input type="checkbox"/> Marine	
2. Waterbody classification: <input type="checkbox"/> Class A <input checked="" type="checkbox"/> Class B <input type="checkbox"/> Class SA <input type="checkbox"/> Class SB			
3. Is the receiving water is listed in the State’s Integrated List of Waters (i.e., CWA Section 303(d))?		<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
4. If the applicant answered yes to B.2, has the applicant identified the designated uses that are impaired, any pollutants indicated, and whether a final TMDL is available for any of the indicated pollutants in a separate attachment to the NOI?		<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
5. Attach a line drawing or flow schematic showing water flow through the facility including location of intake(s), operations contributing to effluent flow, treatment units, outfalls, and receiving water(s).		<input checked="" type="checkbox"/> Line Drawing Attached  <div style="text-align: right;">✓</div>	
6. List each outfall (numbered sequentially) discharging effluent from the following categories and provide an estimate of the average monthly flow (in gallons per day) for each discharge type. See Parts 1.1 through 1.5 (for MA) or Parts 2.1 through 2.5 (for NH) for descriptions and permit conditions for each discharge type.			
Equipment-related cooling water	Outfalls: 003	1,080,000	gpd
Equipment and floor drain water	Outfalls: 001	.068	gpd
Maintenance-related water	Outfalls: 002	5040	gpd
Facility maintenance-related water during flood/high water events	Outfalls:		gpd
Equipment-related backwash strainer water	Outfalls: 004	7200	gpd

7. For each outfall listed above, provide the following information (attach additional sheets if necessary). Outfalls may be eligible for alternative pH effluent limits. See Parts 1.8 and 2.8 of the permit for additional information. Contact MassDEP or NHDES to determine the required information and protocol to request alternative pH effluent limits.				
Outfall No. 001	Latitude: N 44° 27' 54.8"		Longitude: W 71° 11' 01.1"	
	Discharge is: <input type="checkbox"/> Continuous <input checked="" type="checkbox"/> Intermittent <input type="checkbox"/> Seasonal			
	Maximum Daily Flow	.068 GPD	Average Monthly Flow	<.068 GPD
	Maximum Daily Temperature	Varies °F	Average Monthly Temperature	Varies °F
	Maximum Daily Oil & Grease	15 mg/L	Average Monthly Oil & Grease	<15 mg/L
	Maximum Monthly pH	8.0 s.u.	Minimum Monthly pH	6.5 s.u.
	Alternative pH limits requested? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		State approval attached? <input type="checkbox"/> Yes <input type="checkbox"/> No	
Outfall No. 002	Latitude: N 44° 27' 54.8"		Longitude: W 71° 11' 01.1"	
	Discharge is: <input checked="" type="checkbox"/> Continuous <input type="checkbox"/> Intermittent <input type="checkbox"/> Seasonal			
	Maximum Daily Flow	5760 GPD	Average Monthly Flow	5040 GPD
	Maximum Daily Temperature	Varies °F	Average Monthly Temperature	Varies °F
	Maximum Daily Oil & Grease	15 mg/L	Average Monthly Oil & Grease	<15 mg/L
	Maximum Monthly pH	8.0 s.u.	Minimum Monthly pH	6.50 s.u.
	Alternative pH limits requested? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		State approval attached? <input type="checkbox"/> Yes <input type="checkbox"/> No	

7. For each outfall listed above, provide the following information (attach additional sheets if necessary). Outfalls may be eligible for alternative pH effluent limits. See Parts 1.8 and 2.8 of the permit for additional information. Contact MassDEP or NHDES to determine the required information and protocol to request alternative pH effluent limits.		
Outfall No. 003	Latitude: N 44° 27' 54.6"	Longitude: W 71° 11' 02.3"
	Discharge is: <input checked="" type="checkbox"/> Continuous <input type="checkbox"/> Intermittent <input type="checkbox"/> Seasonal	
	Maximum Daily Flow 1.08 MGD	Average Monthly Flow <1.08 MGD
	Maximum Daily Temperature Varies °F	Average Monthly Temperature Varies °F
	Maximum Daily Oil & Grease 15 mg/L	Average Monthly Oil & Grease <15 mg/L
	Maximum Monthly pH 8.0 s.u.	Minimum Monthly pH 6.50 s.u.
	Alternative pH limits requested? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	State approval attached? <input type="checkbox"/> Yes <input type="checkbox"/> No
Outfall No. 004	Latitude: N 44° 27' 53.1"	Longitude: W 71° 11' 03.5"
	Discharge is: <input checked="" type="checkbox"/> Continuous <input type="checkbox"/> Intermittent <input type="checkbox"/> Seasonal	
	Maximum Daily Flow 7200 GPD	Average Monthly Flow < 7200 GPD
	Maximum Daily Temperature Varies °F	Average Monthly Temperature Varies °F
	Maximum Daily Oil & Grease 15 mg/L	Average Monthly Oil & Grease <15 mg/L
	Maximum Monthly pH 8.0 s.u.	Minimum Monthly pH 6.5 s.u.
	Alternative pH limits requested? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	State approval attached? <input type="checkbox"/> Yes <input type="checkbox"/> No

Outfall No.	Latitude:	Longitude:
	Discharge is: <input type="checkbox"/> Continuous <input type="checkbox"/> Intermittent <input type="checkbox"/> Seasonal	
	Maximum Daily Flow MGD	Average Monthly Flow MGD
	Maximum Daily Temperature                      °F	Average Monthly Temperature                      °F
	Maximum Daily Oil & Grease mg/L	Average Monthly Oil & Grease mg/L
	Maximum Monthly pH s.u.	Minimum Monthly pH s.u.
	Alternative pH limits requested? <input type="checkbox"/> Yes <input type="checkbox"/> No	State approval attached? <input type="checkbox"/> Yes <input type="checkbox"/> No

**C. Best Technology Available for Cooling Water Intake Structures**

Facilities that checked “equipment-related cooling” as one of the discharges in Part B. of this NOI are subject to the following requirements. Facilities that intake more than 2 MGD for use in the facility (i.e., not used in the turbines to generate power) and which use at least 25% of the intake volume exclusively for cooling are not eligible for permit coverage and must submit an individual permit application. See Part 3.3 of the HYDROGP.

1. Does the facility intake water for cooling purposes subject to the BTA Requirements at Part 4 of the HYDROGP?	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No If no, skip to Part D of this NOI.
2. If yes, indicate which technology employed to comply with the general BTA requirements at Part 4.1 of the HYDROGP:	
<input type="checkbox"/> A physical or behavioral barrier located at the first intake encountered by fish on the upstream side of the dam that directs fish towards a downstream passage which safely conveys fish over the dam without being exposed to the CWIS. Has the applicant attached a narrative description of the barrier and provided data to demonstrate that the downstream fish passage effectively transports live fish in a manner that minimizes the likelihood of becoming impinged or entrained at the cooling water intake? <input type="checkbox"/> Yes <input type="checkbox"/> No	



### D. Chemical Additives

1.	Does the facility use or plan to use non-toxic chemicals for pH adjustment?	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
2.	Does the facility use or plan to use chemicals for anti-freeze purposes?	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
3.	If the answer to D.2 is yes, provide the following for <b>EACH</b> chemical additive used for anti-freeze:		
Chemical Name and Manufacturer:			
Maximum Dosage Concentration Used:		Average Dosage Concentration Used:	
Maximum Concentration in Discharge: mg/L		Average Concentration in Discharge: mg/L	
Material Safety Data Sheet (MSDS) or other toxicity documentation for each chemical attached?    Yes <input type="checkbox"/> No			

### E. Endangered Species Act Certification

Appendix 2 to the HYDROGP explains the certification requirements related to threatened and endangered species and designated critical habitat. Indicate under which criteria the discharge is eligible for coverage under the HYDROGP:	
1. ESA eligibility for species under jurisdiction of USFWS	<input type="checkbox"/> <b>Criterion A:</b> No endangered or threatened species or critical habitat are in proximity to discharges or related activities or come in contact with the “action area.” See Appendix 2, Part B for documentation requirements. Documentation attached? <input type="checkbox"/> Yes <input type="checkbox"/> No
	<input checked="" type="checkbox"/> <b>Criterion B:</b> Formal or informal consultation with the USFWS under Section 7 of the ESA resulted in either a no jeopardy opinion (formal consultation) or a written concurrence by USFWS on a finding that the discharges and related activities are “not likely to adversely affect” listed species or critical habitat. Has the operator completed consultation with USFWS and attached documentation? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No If no, is consultation underway? <input type="checkbox"/> Yes <input type="checkbox"/> No

	<input type="checkbox"/> <b>Criterion C:</b> Using the best scientific and commercial data available, the effect of the discharges and related activities on listed species and designated critical habitat have been evaluated. Based on those evaluations, a determination is made by EPA, or by the operator and affirmed by EPA, that the discharges and related activities will have “no effect” on any federally threatened or endangered species or designated critical habitat under the jurisdiction of the USFWS. Has the applicant attached documentation of the “no effect” finding? <input type="checkbox"/> Yes <input type="checkbox"/> No
2. ESA eligibility for species under jurisdiction of NMFS	<p>Is the facility located on: the Connecticut River between the Massachusetts/Connecticut state line and Turners Falls, MA; the Taunton River; the Merrimack River between Lawrence, MA and the Atlantic Ocean; the Piscataqua River including the Salmon Falls and Cocheco Rivers; or a marine water?</p> <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
	If yes, was the applicant authorized to discharge from the facility under the 2009 HYDROGP? <input type="checkbox"/> Yes <input type="checkbox"/> No
	If the discharge is to one of the named rivers above or to a marine water <i>and</i> the facility was not previously covered under the 2009 HYDROGP, has there been any previous formal or informal consultation with NMFS? <input type="checkbox"/> Yes <input type="checkbox"/> No Documentation of consultation attached? <input type="checkbox"/> Yes <input type="checkbox"/> No

**F. National Historic Properties Act Eligibility**

1. Indicate under which criterion the discharge(s) is eligible for covered under the HYDROGP:
<input type="checkbox"/> <b>Criterion A:</b> No historic properties are present.
<input checked="" type="checkbox"/> <b>Criterion B:</b> Historic properties are present. The discharges and related activities do not have the potential to impact historic properties.
<input type="checkbox"/> <b>Criterion C:</b> Historic properties are present. The discharges and related activities have the potential to impact or adversely impact historic properties.

2.	Has the applicant attached supporting documentation for NHPA eligibility described in Appendix 3, Part C of the HYDROGP? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
3.	Does supporting documentation include a written agreement from the State Historic Preservation Officer, Tribal Historic Preservation Officer, or other tribal representative that outlines measures the operation will carry out to mitigate or prevent any adverse effects on historic properties? <input type="checkbox"/> Yes <input type="checkbox"/> No

**G. Supplemental Information**

Please provide any supplemental information, including antidegradation review information applicable to new or increased discharges. Attach any certifications required by the HYDROGP. Supplemental information attached? <input type="checkbox"/> Yes <input type="checkbox"/> No
---

**H. Signature Requirements**

1.	The NOI must be signed by the operator in accordance with the signatory requirements of 40 C.F.R. § 122.22, including the following certification:	
	<i>I certify under penalty of law that no chemical additives are used in the discharges to be authorized under this General Permit except for those used for pH adjustment or anti-freeze purposes and that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those directly responsible for gathering the information, I certify that the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I certify that I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.</i>	
2.	Notification provided to the appropriate State, including a copy of this NOI, if required?	<input type="checkbox"/> Yes <input type="checkbox"/> No
	Signature: 	Date: Click or tap to enter a date. <i>04-25-2023</i>
	Print Name and Title: <i>Sean J. Iller , EHS Manager</i>	

**Public Service Company of New Hampshire  
Smith Hydro Station**

**Equipment and Floor Drain Water**

Outfall	Description	Location	Contributing Operations	Average Flow	Total Average Flow	Occasional or Consistent Discharge	Discharging Water	Sample Location or Representative Outfall	Possible Annual Sampling
001	Floor Drains	N 44° 27' 54.8" W 71° 11' 01.1"	Floor drains	0-50 GPY	0-50 GPY	Intermittent	Androscoggin River	Grab sample from floor before discharge	Yes

**Combined Equipment and Floor Drain Water and Maintenance-Related Water**


002	Turbine Sump	N 44° 27' 54.8" W 71° 11' 01.1"	Bearing water seal	3 GPM	3-4 GPM	Consistent	Androscoggin River	Grab sample from sump	Yes
			Wheel pit sump	0-50 GPY					
			Scroll case drain	0-50 GPY					
			Draft tube access pit discharge	0-50 GPY					

**Equipment - Related Cooling Water**

003	Non-Contact Cooling Water	N 44° 27' 54.6" W 71° 11' 02.3"	Air cooling water	500 GPM	750 GPM	Consistent	Androscoggin River	Sample from valve on discharge pipe	Yes
			Thrust bearing cooling water	250 GPM					

**Equipment-Related Backwash Strainer Water**

004	Backwash Strainer	N 44° 27' 53.1" W 71° 11' 03.5"	Backwash cooling water	5 GPM	Variable	Consistent	Androscoggin River	Discharge inaccessible	No
			River overflow	variable					

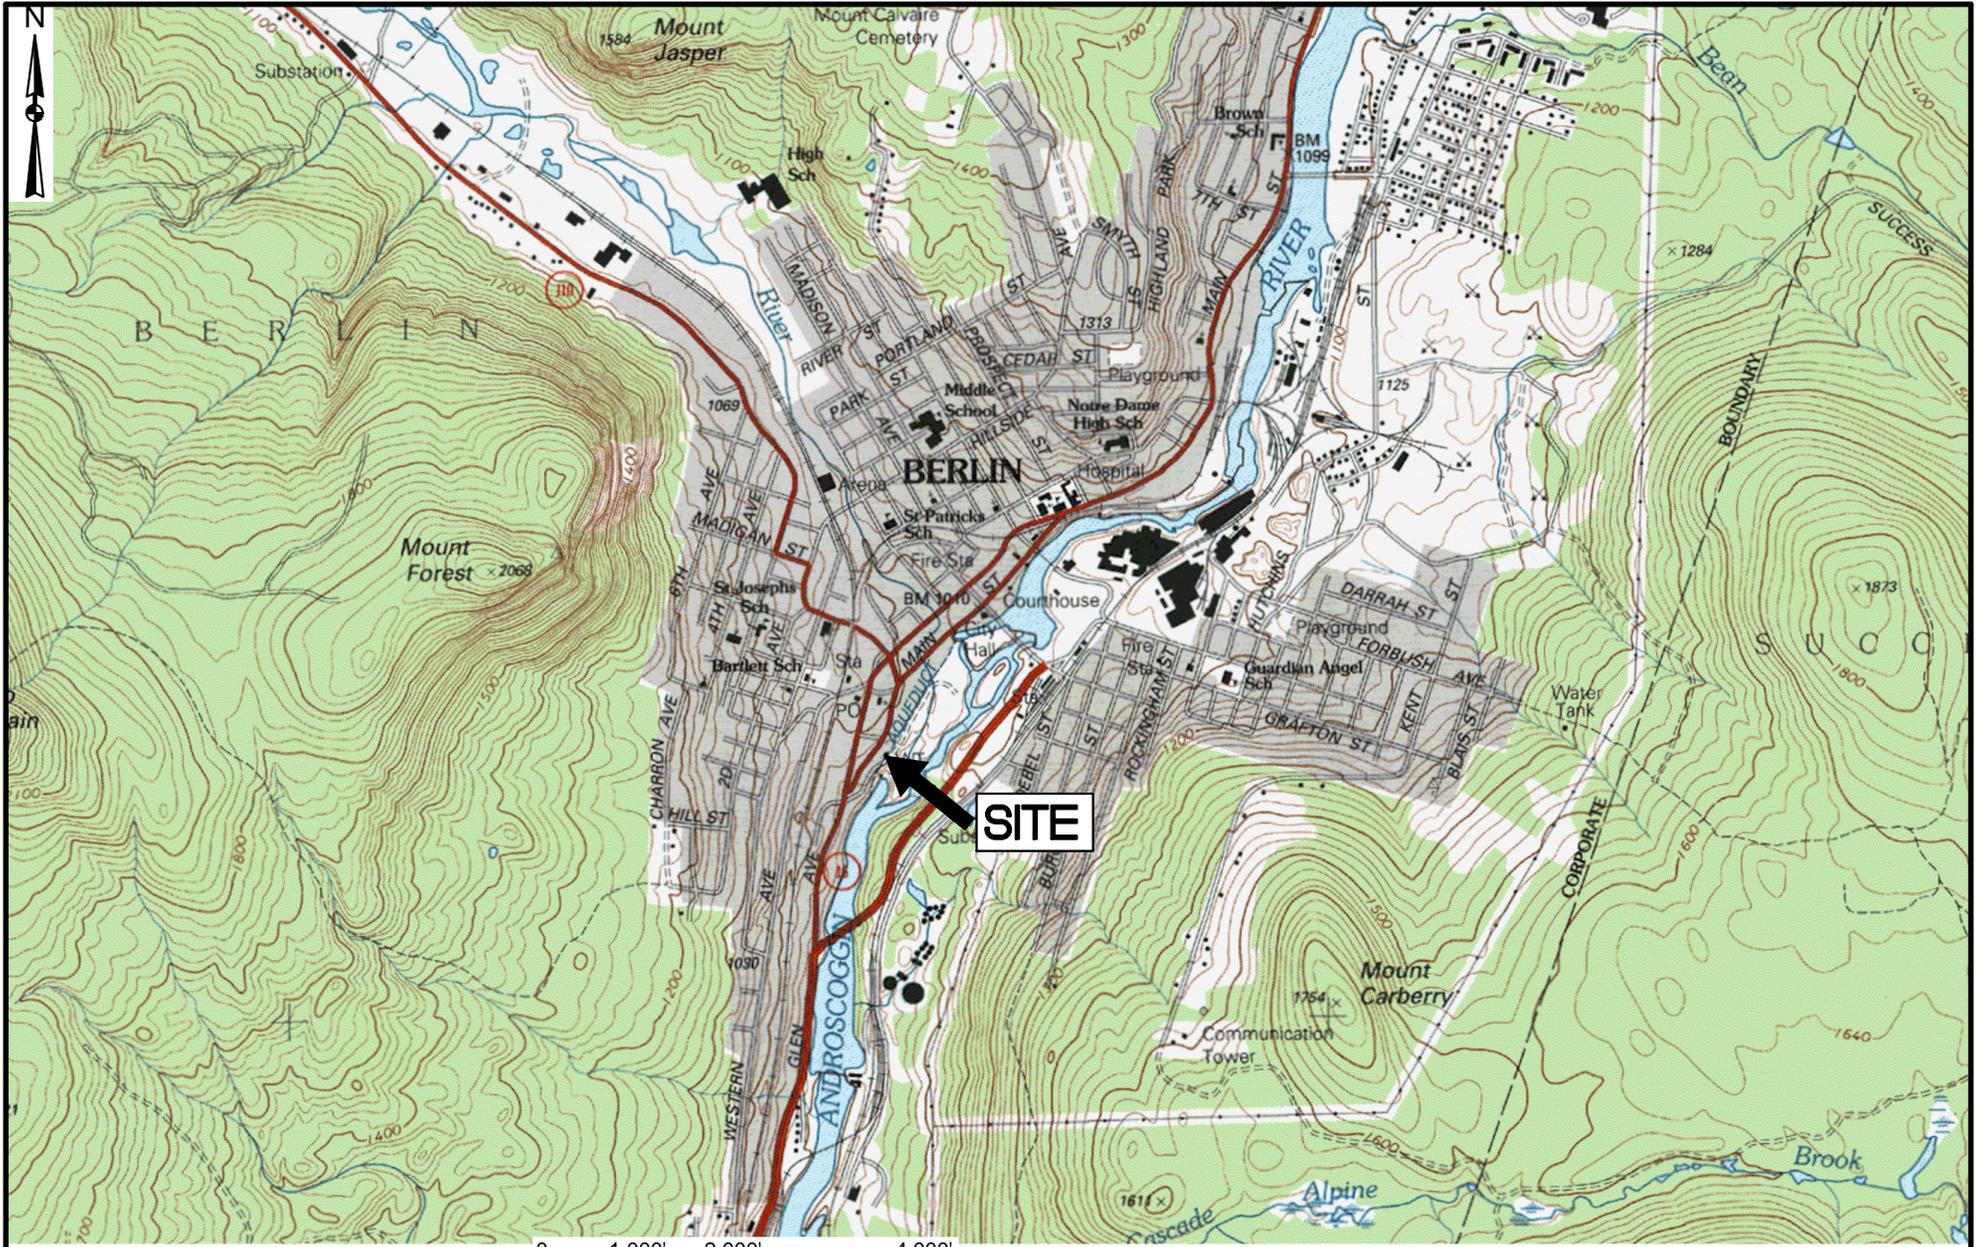

PREPARED BY:  GZA GeoEnvironmental, Inc.  
Engineers and Scientists  
380 HARVEY ROAD  
MANCHESTER, NEW HAMPSHIRE 03103  
(603) 623-3600

PREPARED FOR:  
PUBLIC SERVICE OF NEW HAMPSHIRE

**NPDES HYDROELECTRIC GENERATING  
FACILITIES GENERAL PERMIT  
PUBLIC SERVICE OF NEW HAMPSHIRE  
SMITH STATION  
99 GLEN AVENUE, BERLIN NEW HAMPSHIRE 03570**

NO.	ISSUE/DESCRIPTION	BY	DATE
	PROJ MGR: KDB		DATE
	DESIGNED BY: DMZ		NOVEMBER 2010
	REVIEWED BY: DSJ		PROJECT NO.
	DRAWN BY: MA		04.0024931.03
	CHECKED BY: KDB		REVISION NO.
	SCALE: AS SHOWN		

LOCUS PLAN

FIGURE 1

SHEET NO.



permittee, or the United States on a storage reservoir or other headwater improvement during the term of the original license (including extensions of that term by annual licenses), and if those headwater benefits were not previously assessed and reimbursed to the owner of the headwater improvement, the Licensee shall reimburse the owner of the headwater improvement for those benefits, at such time as they are assessed. The benefits will be assessed in accordance with Subpart B of the regulations.

Article 204. The Commission reserves authority, in the context of a rulemaking proceeding or a proceeding specific to this license, to require the Licensee at any time to conduct studies, make financial provisions, or otherwise make reasonable provisions for decommissioning of the project. The terms of this article shall be effective unless the Commission, in Docket No. RM93-23, finds that the Commission lacks statutory authority to require such actions, or otherwise determines that the article should be rescinded.

Article 205. The Commission reserves authority, in the context of any licensing, relicensing, or license or exemption amendment proceeding involving the upstream Androscoggin River Basin projects located at Mooselookmeguntic Lake, Richardson Lake, the Aziscohos Project No. 4026, the Errol Project No. 3133, the Pontook Project No. 2861, or the Kennebago Project No. 4413, to require the Licensee, in a proceeding specific to this license, to conduct studies, modify minimum flow releases, or otherwise make reasonable provisions for modifying project

□

Project No. 2287-003

- 10 -

facilities or operation as necessary to mitigate or avoid cumulative effects identified in environmental analyses of these upstream projects.

Article 401. The Licensee shall operate the project in a run-of-river mode for the protection of fish and wildlife resources and water quality in the Androscoggin River. The Licensee shall at all times act to minimize the fluctuation of the reservoir surface elevation by maintaining a discharge from the project so that, at any point in time, flows, as measured immediately downstream from the project tailrace, approximate the sum of inflows to the project reservoir. Run-of-river operation may be temporarily modified if required by operating emergencies beyond the control of the Licensee, or for short periods upon mutual agreement between the Licensee, the New Hampshire Fish and Game Department, and the U.S. Fish and Wildlife Service. If the flow is so modified, the Licensee shall notify the Commission as soon as possible, but no later than 10 days after each such incident.

Article 402. The Licensee shall release from the J. Brodie Smith dam into the Androscoggin River a minimum flow of 20 cubic feet per second, as measured immediately below the J. Brodie Smith dam, or inflow to the project reservoir, whichever is less, for the protection and enhancement of fish and wildlife resources

Smith's FERC License.txt

and water quality in the bypassed reach of the Androscoggin River. This flow may be temporarily modified if required by operating emergencies beyond the control of the Licensee, or for short periods upon agreement between the Licensee, the New Hampshire Fish and Game Department, and the U.S. Fish and Wildlife Service. If the flow is so modified, the Licensee shall notify the Commission as soon as possible, but no later than 10 days after each such incident.

Article 403. Within six months from the effective date of the license, the Licensee shall file with the Commission for approval, a plan to monitor run-of-river operation and minimum flows of the project, as stipulated by articles 401 and 402, respectively, and to describe how flows will be maintained below the project when the impoundment is refilled after any maintenance and/or repairs.

The plan shall include, but not be limited to, a schedule for installing the monitoring equipment, the proposed location, design, and calibration of the monitoring equipment, the method of flow data collection, and a provision for providing flow data to the consulted agencies, within 30 days from the date of the agencies request for the data.

The Licensee shall prepare the plan after consultation with the U.S. Geological Survey, the U.S. Fish and Wildlife Service, the New Hampshire Fish and Game Department. The Licensee shall

□

Project No. 2287-003

- 11 -

include with the plan documentation of consultation and copies of comments and recommendations on the completed plan after it has been prepared and provided to the agencies, and specific descriptions of how the agencies' comments are accommodated by the plan. The Licensee shall allow a minimum of 30 days for the agencies to comment and to make recommendations prior to filing the plan with the Commission. If the Licensee does not adopt a recommendation, the filing shall include the Licensee's reasons, based on project-specific information.

The Commission reserves the right to make changes to the plan. Upon Commission approval of the plan, the Licensee shall implement the plan including any changes required by the Commission.

If the results of monitoring indicate that changes in project structures or operations are necessary to ensure run of river operation or maintenance of minimum flows, the Commission may direct the Licensee to modify project structures or operations.

Article 404. Authority is reserved to the Commission to require the licensee to construct, operate, and maintain, or provide for the construction, operation, and maintenance of, such fishways as may be prescribed by the Secretary of the Interior.

Article 405. Within six months of the effective date of the

license, the Licensee shall file with the Commission for approval, a plan to monitor dissolved oxygen (DO) levels and temperature of the Androscoggin River upstream and downstream of the project. The purpose of this monitoring plan is to ensure that stream flows, as measured immediately upstream of the impoundment, downstream of the project dam, and downstream of the project tailrace, maintain a DO content of no less than 75 percent saturation.

The monitoring plan shall include a schedule for:

- (1) implementation of the monitoring plan;
- (2) consultation with the appropriate federal and state agencies concerning the results of the monitoring; and
- (3) filing the results, agency comments, and Licensee's response to agency comments with the Commission.

The Licensee shall prepare the monitoring plan after consultation with the New Hampshire Department of Environmental Services, the New Hampshire Fish and Game Department, and the U.S. Fish and Wildlife Service. The Licensee shall include with the plan documentation of consultation and copies of comments and recommendations on the completed monitoring plan after it has

□

Project No. 2287-003

- 12 -

been prepared and provided to the agencies, and specific descriptions of how the agencies' comments are accommodated by the monitoring plan. The Licensee shall allow a minimum of 30 days for the agencies to comment and to make recommendations prior to filing the monitoring plan with the Commission. If the Licensee does not adopt a recommendation, the filing shall include the Licensee's reasons, based on project-specific information.

The Commission reserves the right to require changes to the monitoring plan. Upon Commission approval, the Licensee shall implement the monitoring plan, including any changes required by the Commission.

If the results of monitoring indicate that changes in project structures or operations are necessary to ensure maintenance of the state DO standard, the Commission may direct the Licensee to modify project structures or operations.

Article 406. The Licensee shall implement the provisions of the "Programmatic Agreement Among the Federal Energy Regulatory Commission, the Advisory Council on Historic Preservation, and the New Hampshire Division for Historic Preservation, for Managing Historic Properties Likely to be Affected by Continuing to Operate the Sawmill Project, Project No. 2422, Cross Power Project, Project No. 2326, Cascade Project, Project No. 2327, Gorham Project, Project No. 2311, Shelburne Project, Project No. 2300, J. Brodie Smith Project, Project No. 2287, and Gorham Project, Project No. 2288, All Located on the Androscoggin River"

Smith's FERC License.txt  
executed on November 18, 1993. The Commission reserves the authority to require changes to the Cultural Resources Management Plan or plans at any time during the term of the license.

Article 407. Within six months from the effective date of this license the Licensee shall file revised project boundary drawings that incorporate the piece of land between the penstock and the bypassed reach into the project boundary and reserve it for future public use if and when Berlin develops a specific proposal for the site.

Article 408. Within six months from the effective date of this license, the Licensee shall develop and file, for Commission approval, a plan for aesthetic enhancements.

The plan must include, but not be limited to:

(1) provisions for painting the surge tank and penstock with a color that blends with the surrounding environment;

(2) provisions to install plant material that screens the view of the surge tank from Route 16 and;

Project No. 2287-003

- 13 -

(3) a schedule for completing items (1) and (2).

The Licensee shall prepare the plan after consultation with the City of Berlin, Parks and Recreation Department and the National Park Service. The Licensee shall include with the plan, documentation of consultation, copies of comments and recommendations on the completed plan after it has been prepared and provided to the agencies, and specific descriptions of how the agencies' comments are accommodated by the plan. The Licensee shall allow a minimum of 30 days for the agencies to comment and to make recommendations before filing the plan with the Commission. If the Licensee does not adopt a recommendation, the filing shall include the Licensee's reasons, based on project-specific information.

The Commission reserves the right to require changes to the plan. Upon Commission approval, the Licensee shall implement the plan, including any changes required by the Commission.

Article 409. Within one year from the effective date of this license, the Licensee shall develop and file, for Commission approval, a land protection plan. The plan shall be designed to protect the aesthetics and public access of all undeveloped land between the bypassed reach and the project penstock at the J. Brodie Smith Project.

The plan shall include, but not be limited to:

(1) maps delineating the protected land area; and

(2) provisions for: (a) maintaining prescribed minimum-width buffer zones, no tree-cutting, public roads, and private

Inventory #	Property Name	Address	Town	NR Listing Date
ACW0001	Acworth Congregational Church	Town Common	Acworth	6/13/1975
ACW0002	Acworth Silsby Library	Cold Pond and Lynn Hill Road	Acworth	12/8/1983
ALB0049	Russell-Colbath House	Kancamagus Highway	Albany	4/23/1987
ALL0007	Allenstown Meeting House	Deerfield Road	Allenstown	12/6/2004
ALL0013	Bear Brook State Park Civilian Conservation Corps	Allenstown-Deerfield Road intersection	Allenstown	4/23/1992
ALS0004	Jewett-Kemp-Marlens House	North Road	Alstead	5/30/1997
ALS0048	Shedd-Porter Memorial Library	3 Main Street	Alstead	12/27/2010
ALS0050	Hutchinson House	400 Alstead Center Road	Alstead	2/2/2015
ALTO001	Alton Bay Railroad Station	Route 11	Alton	9/22/1983
ALTO002	First Congregational Church	Church Street	Alton	3/9/1990
ALTO003	First Freewill Baptist Church	Drew Hill Road	Alton	8/1/1978
ALTO004	Second Free Baptist Church	Main Street, PO Box 338	Alton	3/9/1990
AMH0028	The Wigwam/The Old Methodist Church	Middle/Cross Street	Amherst	8/18/1982
AMH0031	Hildreth-Jones Tavern	18 Jones Road	Amherst	8/18/1982
AMH0043	Amherst Village Historic District	Mack Hill, Amherst Street, Davis, Foundry	Amherst	8/18/1982
AND0001	Bog Bridge	unidentified road over Pleasant Brook	Andover	3/16/1989
AND0002	Keniston Bridge	Bridge Road	Andover	3/16/1989
AND0003	Potter Place Railroad Station	Depot Street	Andover	3/16/1989
AND0009	Gershom Durgin House	Route 11, just west of Plains Road	Andover	10/26/2000
AND0015	Tucker Mountain School	Tucker Mountain Road	Andover	3/18/2005
AND0027	East Andover Village Center Historic District	Route 11, Chase Hill Road	Andover	3/16/1989
AND0028	Hersey Farms Historic District	1057 & 1088 Franklin Highway	Andover	6/10/2008
ANT0001	The Flint Estate	Old Keene Road	Antrim	12/13/1984
ASH0001	Ashland Grist Mill and Dam	Main Street	Ashland	12/10/1979
ASH0002	Ashland Railroad Station	39 Depot Street	Ashland	11/10/1982
ASH0003	Ashland Junior High School	12 School Street	Ashland	4/8/1983
ASH0035	Ashland Town Hall	10 Highland Street	Ashland	3/24/1983
ASH0036	First Freewill Baptist Church	13-15 Main Street	Ashland	4/8/1983
ASH0037	Saint Mark's Episcopal Church	6-8 Highland Street	Ashland	12/13/1984
ASH0038	Whipple House	4 Pleasant Street	Ashland	12/13/1978
ATK0005	Atkinson Academy School	17 Academy Avenue	Atkinson	8/26/1980
BAR0016	Oscar Foss Memorial Library	111 South Barnstead Road	Barnstead	11/7/1985
BAT0030	Goodall-Woods Law Office	Route 302, east side 2.75 mi. south of Landaff lin	Bath	8/26/1980
BAT0034	Jeremiah Hutchins Tavern	Route 302, west side 2.65 mi. south of Landaff Lin	Bath	9/7/1984
BAT0058	Bath Covered Bridge	off Route 302 over the Ammonoosuc River	Bath	9/1/1976
BAT0061	The Brick Store	Route 302, west side, Bath Village Green	Bath	11/7/1985
BAT0092	Swiftwater Covered Bridge	Porter Road over Ammonoosuc River	Bath	11/21/1976
BED0029	Bedford Town Hall	10 Meetinghouse Road	Bedford	12/13/1984
BED0212	Bedford Presbyterian Church	4 Church Road	Bedford	6/12/2007
BEL0112	Belmont Public Library	Main Street	Belmont	9/12/1985
BER0042	George E. Burgess School/Notre Dame High School	411 School Street	Berlin	6/25/2015
BER0049	Congregational Church	921 Main Street	Berlin	1/4/1980
BER0050	Holy Resurrection Orthodox Church	Petrograd Street	Berlin	5/16/1979
BER0051	St. Anne Church	58 Church Street	Berlin	5/29/1979
BER0082	Saint Anne Historic District	Pleasant, Main, Church, School and Success Streets	Berlin	9/18/2018
BET0019	Rocks Estate	Route 302 and Glessner Road	Bethlehem	9/7/1984
BET0023	Burt-Cheney Farm	Rt. 302	Bethlehem	3/25/1982
BET0024	Felsengarten	Lewis Hill Road	Bethlehem	6/18/1973
BOS0014	Boscawen Academy & "Much-I-Do" Hose House	226 King Street	Boscawen	12/8/1980
BOS0015	Boscawen Public Library	250 King Street	Boscawen	5/28/1981
BOS0016	First Congregational Church of Boscawen	12 High Street	Boscawen	4/19/1982
BOS0017	Morrill-Lassonde Property	150 King Street	Boscawen	3/15/1984
BRA0019	Bement Covered Bridge	Center Road	Bradford	11/21/1976
BRA0020	Bradford Center Meetinghouse	18 Rowe Mountain Road	Bradford	6/13/2014
BRA0021	Bradford Town Hall	West Main Street	Bradford	11/13/1980
BRI0044	Bristol Town Hall	45 Summer Street	Bristol	9/29/2015
BRI0059	Minot-Sleeper Library	14 Pleasant Street	Bristol	9/15/1988
BRI0060	Central Square Historic District	Central Square	Bristol	3/24/1983
BRK0001	Brookfield Town Hall	Route 109	Brookfield	6/6/1985
BRR0009	Canaan Chapel	Route 202 & Canaan Back Road	Barrington	3/11/1982
BRT0033	Bartlett Engine House	Route 302	Bartlett	9/29/2015
CAN0020	Canaan Meetinghouse	Canaan Street	Canaan	3/24/1972
CAN0021	Canaan Street Historic District	Canaan St.	Canaan	5/7/1973
CAR0022	Crawford Depot	NW of Saco Lake, off Rt. 302	Carroll	4/29/1982
CAR0023	Mount Washington Hotel	310 Mount Washington Road	Carroll	9/27/1978
CAR0024	Fabyan Guard Station	Old Cherry Mountain Road	Carroll	5/14/2018
CEN0009	Centre Harbor Village Historic District	Main and Plymouth Sts.	Center Harbor	9/8/1983
CHA0006	Sumner House	40 Main Street	Charlestown	6/10/1987
CHA0007	Sumner Carriage House	River Street	Charlestown	6/10/1987
CHA0017	Silsby Free Public Library	226 Main Street	Charlestown	6/10/1987
CHA0021	Farwell School	Route 12-A	Charlestown	12/6/1990
CHA0022	Charlestown Town Hall	N. side of Summer Street, off Main St	Charlestown	3/15/1984
CHA0023	North Charlestown Historic District	River Rd.	Charlestown	6/9/2005
CHA0024	Charlestown Main Street Historic District	Main St.	Charlestown	6/10/1987
CHE0008	Chester Congregational Church	4 Chester Street	Chester	6/5/1986
CHE0009	Chester Village Cemetery	Intersection of Routes 102 and 121	Chester	11/29/1979
CHE0010	Stevens Memorial Hall	1 Chester Street	Chester	9/10/2004
CHI0048	Depot Road Bridge	0.15 mi. E of NH 28 on Depot Rd.	Chichester	3/10/2004
CHS0012	Asbury United Methodist Church	536 Route 63	Chesterfield	12/21/1983
CLA0122	Claremont City Hall (Claremont Opera House)	Tremont Square	Claremont	4/26/1973
CLA0123	David Dexter House	Lincoln Heights	Claremont	11/29/1979
CLA0124	English Church	Old Church Road	Claremont	2/1/1980
CLA0125	William Rossiter House	11 Mulberry Street	Claremont	5/25/1979
CLA0126	Claremont Warehouse No. 34	Heritage Place	Claremont	2/28/1979
CLA0127	Lower Village District	Along Central Street and Main Street	Claremont	2/21/1978
CLA0128	Monadnock Mills	Banks of Sugar River	Claremont	2/15/1979
CLM0008	Wallace Farm	28 Wallace Farm Road	Columbia	12/13/2001
CLM0015	Columbia Covered Bridge	Columbia Bridge Road	Columbia	12/12/1976
CND0005	Smyth Library	194 High Street	Candia	9/13/2007
CNT0015	Canterbury Shaker Village	288 Shaker Road	Canterbury	6/17/1975
CNW0106	North Conway 5 Cents and 10 Cents Store	2683 White Mountain Highway/Main Street	Conway	1/5/2004
CNW0171	William K. Eastman House	100 White Mountain Highway/ Main Street	Conway	6/6/2001

<b>Inventory #</b>	<b>Property Name</b>	<b>Address</b>	<b>Town</b>	<b>SR Listing Date</b>
ACW0007	Acworth Town Hall	13 Town Hall Road	Acworth	1/27/2003
ACW0013	Acworth Horse Sheds	Town Hall Road	Acworth	4/25/2016
ALL0007	Allenstown Meeting House	Deerfield Road	Allenstown	7/26/2004
ALL0010	Allenstown Public Library	59 Main Street	Allenstown	4/28/2008
ALS0013	Chase's Mill	801 Forest Road	Alstead	7/25/2016
ALS0048	Shedd-Porter Memorial Library	3 Main Street	Alstead	1/24/2011
ALS0049	Wilder Farm	349 Alstead Center Road	Alstead	10/29/2018
ALT0024	Letter S Road Trestle Bridge Supports	RR ROW over Letter S Road and Merry Meeting River	Alton	10/31/2016
AMH0031	Hildreth-Jones Tavern	18 Jones Road	Amherst	1/26/2004
AND0030	Andover Town Hall	157 Main Street	Andover	4/26/2021
ASH0039	Reuben Whitten House	14 Pleasant Street	Ashland	4/25/2015
BAR0005	Sellin Farm	305 Gilmanton Road	Barnstead	1/27/2003
BAT0062	Bath Congregational Church	6 West Bath Road	Bath	11/20/2013
BEL0053	Gale School	60 Concord Street	Belmont	7/30/2018
BEL0058	Province Road Meeting House	251 Province Road	Belmont	1/27/2003
BEL0059	Belmont Bandstand	40 Mill Street Extension	Belmont	4/25/2016
BEL0113	Belmont Mill	14 Mill Street	Belmont	10/26/2015
BEN0003	High Street Cemetery	High Street and North-South Road	Benton	1/30/2012
BER0014	St. Kieran's Parish Church	155 Emery Street	Berlin	10/28/2002
BER0015A	Brown Company Barns -- Thompson Farm Barn	137 East Milan Road	Berlin	4/28/2003
BER0015B	Brown Company Barns -- Maynesboro Farm Barn	137 East Milan Road	Berlin	4/28/2003
BER0023	Mt. Forist Grange Cemetery	East Milan Road, east side	Berlin	7/25/2005
BET0005	Colonial Theater	2050 Main Street	Bethlehem	4/29/2002
BET0006	Burch House	249 Main Street	Bethlehem	10/28/2002
BET0017	Mt. Washington Cemetery	Main Street and Prospect Street	Bethlehem	7/31/2006
BET0028	Ranlet Café	2182 Main Street	Bethlehem	4/29/2019
BET0031	Lady of the Fairways	Route 302	Bethlehem	1/25/2021
BNN0003	Monadnock Paper Mills Complex	Antrim Road	Bennington	7/28/2008
BNN0004	Paper Mill Dam (22.06)		Bennington	7/28/2008
BNN0012	Alberto's Restaurant	79-81 Antrim Road	Bennington	7/28/2008
BNN0014	Benjamin Whittmore House	4 Bible Hill Road	Bennington	7/28/2008
BNN0016	House	16 Bible Hill Road	Bennington	7/28/2008
BNN0021	House	50 Bible Hill Road	Bennington	10/27/2008
BNN0022	House	56 Bible Hill Road	Bennington	7/28/2008
BNN0025	House	43 Bible Hill Road	Bennington	7/28/2008
BNN0026	Fleming House	39 Bible Hill Road	Bennington	10/27/2008
BNN0028	Nathan Whitney House	27 Bible Hill Road	Bennington	7/28/2008
BNN0029	House	7 Old Stagecoach Road	Bennington	7/28/2008